



**ADDENDUM NO. 2
TO
PROJECT NO. TMUA-W 18-19 C2
A.B. JEWELL WATER TREATMENT PLANT CLARIFIER NO. 3 IMPROVEMENTS**

This Addendum No. 1 consisting of (4) items, submitted by Jacobs, is hereby made a part of the Contract Documents to the same extent as though it were originally included therein, and shall supersede anything contained in the Plans and Specifications with which it might conflict. **This entire Addendum shall be attached to the Index Sheet of the Contract Documents, recorded on P-4a of the proposal, and submitted with bid. Failure to do so shall result in the bid being deemed non-responsive.**

This Addendum No. 2 consists of the following:

1. The attached documents list the detailed items that have been modified in Addendum No. 2. These documents shall be inclusive and apply to this project.

All other provisions of the Plans and Specifications shall remain in full force and effect.

CITY OF TULSA

Paul D. Zachary
Paul D. Zachary, P.E.
City Engineer

HAS
HAS/CW/AT/kt

July 5, 2022

ADDENDUM NO. 2

**PROJECT NO. TMUA-W 18-19 C2 AB JEWELL WATER TREATMENT PLANT
CLARIFIER NO. 3 IMPROVEMENTS**

This Addendum No. 2 consisting of 4 Items is hereby made a part of the Contract Documents to the same extent as though it were originally included therein and shall supersede anything contained in the Plans and Specifications with which it might conflict. **This addendum shall be attached to the Index Sheet of the Contract Documents and submitted with the bid. Failure to do so shall result in the bid being deemed non-responsive.**

This Addendum No. 2 consists of the following:

SPECIFICATIONS VOLUME I

- 1) **Bid Item 49, CHANGE** from Quantity 2 to Quantity 1.
- 2) **Delete the existing Proposal in its entirety and replace with the Proposal found at: <https://www.cityoftulsa.org/government/departments/engineering-services/construction-bids/> and attached hard copy for Project No. TMUA-W 18-19 C2. *It is the Bidder's responsibility to download the revised Proposal onto their thumb drives.***

DRAWINGS

- 3) **01-G-003, CHANGE** Item Number 49 from Quantity 2 to Quantity 1.
- 4) **99-C-501, ADD** Detail 3123-110.

All other provisions of the Plans and Specifications shall remain in full force and effect.
Jacobs Engineering Group Inc.



Luke Lenard, PE
Engineer of Record



Appended hereto and part of Addendum No. 1:

Photographs: **None**

ADDENDUM NO. 2
PROJECT NO. TMUA-W 18-19 C2
AB JEWELL WATER TREATMENT PLANT CLARIFIER NO. 3 IMPROVEMENTS

Specifications: **None**


Drawings: **01-G-003**

99-C-501

END OF ADDENDUM

ITEM NUMBER	SUMMARY OF CONTRACT QUANTITIES	UNIT	QUANTITY
01	CONCRETE	EA	1
02	CONCRETE	EA	1
03	CONCRETE	EA	1
04	CONCRETE	EA	1
05	CONCRETE	EA	1
06	CONCRETE	EA	1
07	CONCRETE	EA	1
08	CONCRETE	EA	1
09	CONCRETE	EA	1
10	CONCRETE	EA	1
11	CONCRETE	EA	1
12	CONCRETE	EA	1
13	CONCRETE	EA	1
14	CONCRETE	EA	1
15	CONCRETE	EA	1
16	CONCRETE	EA	1
17	CONCRETE	EA	1
18	CONCRETE	EA	1
19	CONCRETE	EA	1
20	CONCRETE	EA	1
21	CONCRETE	EA	1
22	CONCRETE	EA	1
23	CONCRETE	EA	1
24	CONCRETE	EA	1
25	CONCRETE	EA	1
26	CONCRETE	EA	1
27	CONCRETE	EA	1
28	CONCRETE	EA	1
29	CONCRETE	EA	1
30	CONCRETE	EA	1
31	CONCRETE	EA	1
32	CONCRETE	EA	1
33	CONCRETE	EA	1
34	CONCRETE	EA	1
35	CONCRETE	EA	1
36	CONCRETE	EA	1
37	CONCRETE	EA	1
38	CONCRETE	EA	1
39	CONCRETE	EA	1
40	CONCRETE	EA	1
41	CONCRETE	EA	1
42	CONCRETE	EA	1
43	CONCRETE	EA	1
44	CONCRETE	EA	1
45	CONCRETE	EA	1
46	CONCRETE	EA	1
47	CONCRETE	EA	1
48	CONCRETE	EA	1
49	CONCRETE	EA	1
50	CONCRETE	EA	1
51	CONCRETE	EA	1
52	CONCRETE	EA	1
53	CONCRETE	EA	1
54	CONCRETE	EA	1
55	CONCRETE	EA	1
56	CONCRETE	EA	1
57	CONCRETE	EA	1
58	CONCRETE	EA	1
59	CONCRETE	EA	1
60	CONCRETE	EA	1
61	CONCRETE	EA	1
62	CONCRETE	EA	1
63	CONCRETE	EA	1
64	CONCRETE	EA	1

GENERAL LEGEND

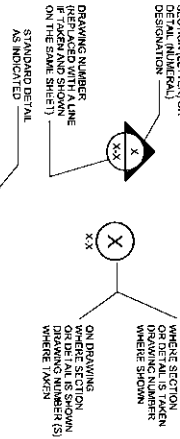

DETAIL AND SECTION DESIGNATION

BID SCHEDULE

THE UNIT PRICE WORK IS DESCRIBED IN MORE DETAIL IN SECTION 01.30 BY PAYMENT PROCEDURES.

GENERAL NOTES:

1. FEATURES ARE SHOWN, HEAVY LINES, SCREENING IS USED IN PROXY TO CLARIFY DRAWINGS. FOR EXAMPLE, STRUCTURES ARE SCREENED ON MECHANICAL DRAWINGS TO HIGHLIGHT PIPING AND EQUIPMENT.
2. RECONSTRUCTION WORK IS SHOWN BY SHADING FACILITIES TO BE REMOVED CROSS-HATCHED.
3. REPEITIVE FEATURES ARE NOT DRAWN IN THEIR ENTIRETY AND SHALL BE COMPLETELY PROVIDED AS IF DRAWN IN FULL.
4. LINE OF EXISTING GRADES, AS SHOWN ON THE BUILDING ELEVATIONS AND SECTIONS ARE APPROXIMATE.
5. REFER TO STRUCTURAL, MECHANICAL, ELECTRICAL AND OTHER CATEGORIES OF DRAWINGS FOR ADDITIONAL VARIETY SIZE AND LOCATION OF, AND PROVIDE, ALL OPENINGS THROUGH FLOORS AND WALLS ACCESS DOORS, PARTIAL, CORNER, CLOSURES, AND OTHER EQUIPMENT.
6. VARIETY SIZE AND LOCATION OF, AND PROVIDE, ALL OPENINGS THROUGH FLOORS AND WALLS ACCESS DOORS, PARTIAL, CORNER, CLOSURES, AND OTHER EQUIPMENT.

GENERAL CONSTRUCTION NOTES:

1. BURIED DUCTS, HARNESS LINES, AND CABLES SHALL BE GIVEN TWO COATS OF COPPER'S BITUMASTIC 90M (OVER) MAT, THICKNESS OF 18 MILS OR EQUAL, COST TO BE INCLUDED IN UNIT PRICE BID FOR PIPE AND FITTINGS.
2. CONTRACTOR TO EQUIPATE ALL UTILITY CROSSINGS AHEAD OF PIPE LAYING SO THAT THE GRAPES CAN BE ABLE TO BE PROTECTED WITH WATER MAINS TO AVOID UTILITY COMPETING'S FAILURE TO DO SO SHALL NOT BE THE CONTRACTOR'S RESPONSIBILITY. CROSSINGS SHALL BE INCLUDED IN UNIT PRICE BID FOR PIPE.
3. CONTRACTOR IS REQUIRED TO BED AND BACKFILL ALL TRENCHES EXCAVATED ACROSS ANY EXISTING OR MAXIMUM LIFTS AND COMPACTED TO 98% MODIFIED PROCTOR DENSITY. COST TO BE INCLUDED IN COST OF PIPE INSTALLATION. NO ADDITIONAL PAYMENT SHALL BE MADE.
4. THE CONSTRUCTION CONTINGENCY ALLOWANCE CAN BE USED FOR VARIOUS WORK AND MISCELLANEOUS ITEMS NOT IDENTIFIED IN THE CONTRACT DOCUMENTS WITH THE FOLLOWING PROVISIONS:
 - I. THE ALLOWANCE SHALL BE USED FOR COST OF MATERIALS, LABOR, INSTALLATION, AND OVERHEAD AND PROFIT FOR ADDITIONAL WORK AND MISCELLANEOUS ITEMS THAT ARE NOT IDENTIFIED IN THE CONSTRUCTION DOCUMENTS AND PLANS, AND NOT INCLUDED IN THE BID ITEMS OF THE CONTRACT.
 - II. THE ALLOWANCE SHALL BE USED ONLY AT THE DISCRETION OF THE CITY. ANY ALLOWANCE BALANCE REMAINING AT THE COMPLETION OF THE PROJECT WILL BE CREDITED BACK TO THE CITY ON THE FINAL APPLICATION OF PAYMENT (BID ITEM) FOR THE CONSTRUCTION OF THE PROJECT.
 - III. THE CONTRACTOR SHALL PROVIDE, TO THE CITY, A WRITTEN REQUEST FOR THE USE OF ANY ALLOWANCE RECEIVING A WRITTEN ORDER, FROM THE ENGINEER AND CITY AUTHORIZING SUCH WORK, AT THE CONTRACTOR'S OPTION.
 - IV. THE CONTRACTOR SHALL PROCEED WITH THE WORK INCLUDED IN THE ALLOWANCE ONLY AFTER RECEIVING A WRITTEN ORDER, FROM THE ENGINEER AND CITY AUTHORIZING SUCH WORK, AT THE CONTRACTOR'S OPTION.

GENERAL CONSTRUCTION NOTES:

1. PAY ITEMS LISTED IN THE BID SCHEDULE ARE THE ONLY PAY ITEMS FOR THE PROJECT. ANY OTHER ITEMS NOT LISTED IN THE BID SCHEDULE ARE TO BE INCLUDED IN THE BID SCHEDULE. ALL UTILITY LOCATIONS SHALL BE APPROXIMATE. VERIFY ALL UTILITY LOCATIONS PRIOR TO BIDDING PROJECT. ALL UTILITY LOCATIONS SHALL BE APPROXIMATE. VERIFY ALL UTILITY LOCATIONS PRIOR TO BIDDING PROJECT. ALL UTILITY LOCATIONS SHALL BE APPROXIMATE. VERIFY ALL UTILITY LOCATIONS PRIOR TO BIDDING PROJECT.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY ENGINEER AND CITY AUTHORITY HAVING JURISDICTION AND SHALL PASS AT THE CITY ENGINEER'S DISCRETION.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY ENGINEER AND CITY AUTHORITY HAVING JURISDICTION AND SHALL PASS AT THE CITY ENGINEER'S DISCRETION.
4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE CITY ENGINEER AND CITY AUTHORITY HAVING JURISDICTION AND SHALL PASS AT THE CITY ENGINEER'S DISCRETION.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SURVEYING AND CONSTRUCTION STAKING FOR THE PROJECT.
6. THE CONTRACTOR SHALL OBTAIN ALL REQUIRED TRADE PERMITS PRIOR TO WORK. ALL TRADE LABOR SHALL BE INSPECTED BY THE LOCAL AUTHORITY HAVING JURISDICTION AND SHALL PASS AT THE CITY ENGINEER'S DISCRETION.
7. THE CONTRACTOR SHALL CONDUCT ALL WORK IN ACCORDANCE WITH APPLICABLE OSHA STANDARDS, STATE OF OKLAHOMA AND CITY OF TULSA SHEET REGULATIONS.

SUMMARY OF WORK:

1. INSTALLATION OF NEW CLARIFIER ISOLATION VALVES.
2. MODIFICATIONS TO EXISTING RAW WATER CONTROLLER VAULT.
3. POTABLE WATER AND SLUDGE VAND PIPING.
4. OPERATION OF EXISTING CLARIFIER MECHANISMS, FLOCCULATIONS AND BAPPLES.
5. INSTALLATION OF NEW FLOCCULATION SPACE BAPPLE WALLS AND DIFFUSION WALL.
6. PROCUREMENT AND INSTALLATION OF NEW FLOCCULATION AND DRIVE MECHANISMS, WITH ELECTRICAL AND CONTROL COMPONENTS.
7. CONSTRUCTION OF SLUDGE COLLECTION PIPING, PUMP AND VALVES.
8. INSTALLATION OF PLATE SETTLERS.
9. MODIFICATIONS TO SLUDGE PUMP STATION NO. 1.
10. MODIFICATIONS TO SLUDGE PUMP STATION NO. 2.
11. MODIFICATIONS TO SLUDGE PUMP STATION NO. 3.
12. MODIFICATIONS TO SLUDGE PUMP STATION NO. 4.

GENERAL LEGEND AND NOTES

PROJECT NO: TMAU-W-18-19 C2

CLARIFIER NO. 3 IMPROVEMENTS

CITY OF TULSA, OKLAHOMA

ENGINEER: JACOBS

DATE: 01-15-2025


SCALE: AS SHOWN

DATE: 01-15-2025

FILE NAME: C:\01-000\18-19C2\01-15-2025

PLOT DATE: 01-15-2025

PLOT TIME: 3:08:15 PM

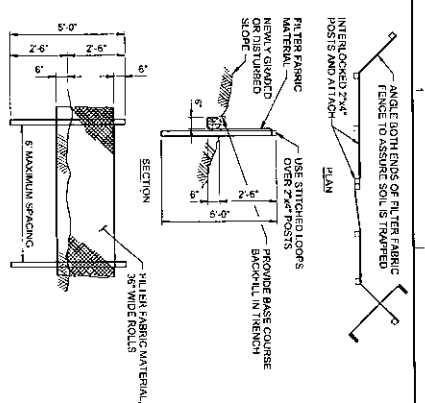


NOTES:

1. BURY BOTTOM OF FILTER FABRIC 6" VERTICALLY BELOW FINISHED GRADE.
2. 2x4 DOUGLAS FIR OR STEEL FENCE POSTS.
3. STITCHED LOOPS TO BE INSTALLED DOWNHILL SIDE OF SLOPE.
4. COMPACT ALL AREAS OF FILTER FABRIC TRENCH.

SEDIMENT FENCE

NTS


3125-165

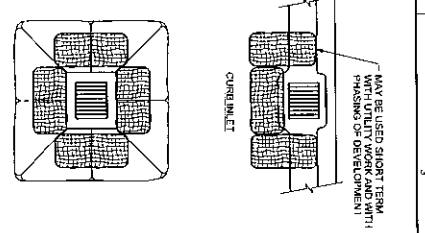

BIOFILTER BAG INLET BARRIER

NTS

3125-186

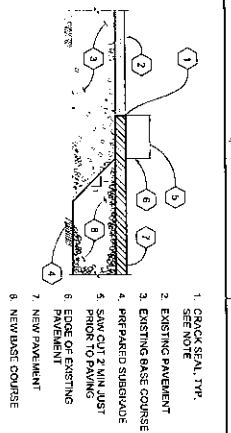


NOTE:
PAINT EDGE OF EXISTING ASPHALT WITH TACK COAT PRIOR TO PAVING CRACK SEAL JOINT AFTER PAVING OPERATION HAS BEEN COMPLETED.

PAVEMENT CONNECTION

NTS

3212-215

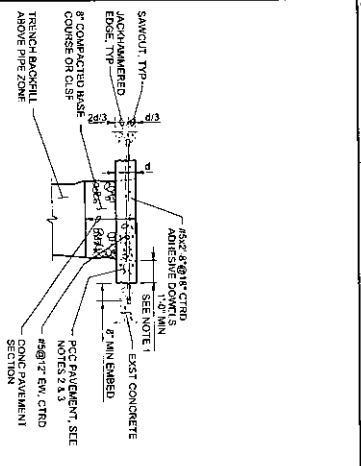


NOTES:

1. IF LOCATION OF TRENCH SAW CUT IS WITHIN 2 FEET OF AN EXISTING JOINT OR EDGE OF CONCRETE, THE SAW CUT SHOULD BE CONCRETE TO THE JOINT OR EDGE.
2. CONSTRUCT JOINTS ACROSS NEW CONCRETE TO MATCH EXISTING JOINT TYPES AND LOCATIONS.
3. PAVEMENT SHALL HAVE A COMPRESSIVE STRENGTH OF 4000 PSI AT THE AGE OF 28 DAYS. THICKNESS SHALL MATCH EXISTING.

SURFACE RESTORATION

NTS

3212-220

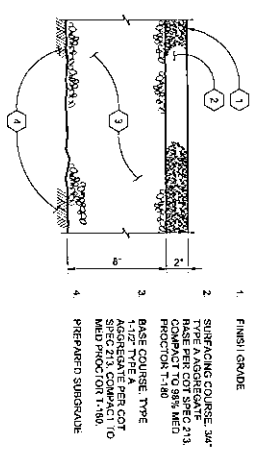


NOTE:
COT = CITY OF TULSA STANDARD SPECIFICATIONS

GRAVEL SURFACING

NTS


3215-260

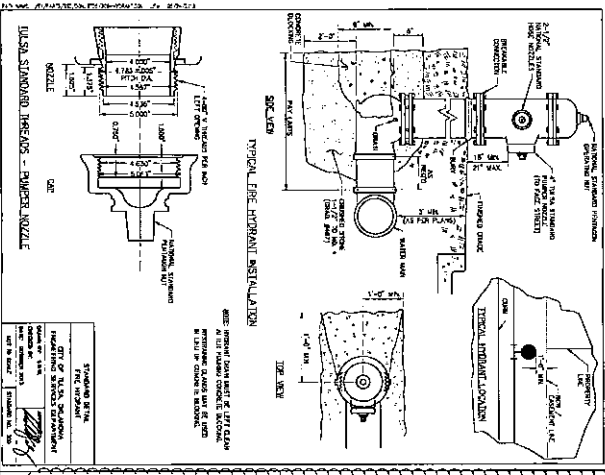

USLA STANDARD HEADS - DWIGER NOZZLE

NTS

3123-110

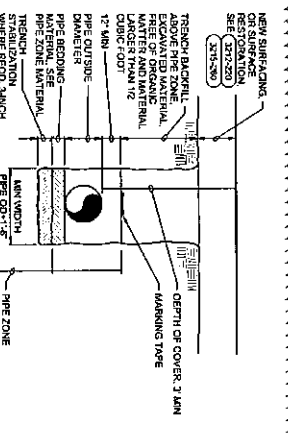

TYPICAL TRENCH

NTS

3123-110

REVISIONS		DATE		BY		CHECKED		APPROVED	
NO.	DESCRIPTION	DATE	BY	DATE	BY	DATE	BY	DATE	BY
1	ADDITION 2	11/7/22	EL	11/7/22	EL				

DATE OF ISSUE	11/15/22
ISSUED BY	EL
CHECKED BY	EL
APPROVED BY	EL
DATE OF REVIEW	11/15/22
REVIEWED BY	EL
DATE OF REVISION	11/15/22
REVISION BY	EL
DATE OF REVISION	11/15/22
REVISION BY	EL

PROJECT NO.	TMAU-W-18-19 C2
PROJECT NAME	AB JEWELL WTP IMPROVEMENTS
CLIENT	CITY OF TULSA, OKLAHOMA ENGINEERING DEPARTMENT
DESIGNER	JACOBS
DATE	11/15/22
SCALE	AS SHOWN
PROJECT LOCATION	18315 AV

ELECTRONIC BID PROPOSAL INSTRUCTIONS - EXCEL SPREADSHEET
PROJECT NO. TMUA-W 18-19 C2

Please read the following instructions carefully.

1. After opening this file re-save it as your company's name.
2. Open the BID FORM Sheet from the tabs below.
3. Input the unit price of the appropriate pay item in the cells highlighted in blue.
4. Review all data input and check calculations to ensure accuracy of Bid.
5. Print 1hardcopy of the "PROPOSAL" tab, BID FORM and the "SIGNATURE PAGE" tab.
6. Complete and sign the "Signature Page" document.
6. Submit hardcopy and electronic disk with Contract Documents and Specifications for Bid opening date.

LEGEND

- \$ 1.00 Cells Requiring Data Input.
- \$ 1.00 Internal Data Transfer.
- \$ 2.00 Calculated Results.

AGREEMENT FOR USING ELECTRONIC BID PROPOSAL

By and Between: _____, (ENGINEER) and RECIPIENT. The enclosed electronic media is provided pursuant to your request and is for your limited use in connection with your submittal of Bid Proposal for Project No. _____. In no event shall the information be used for any other purpose or be released to third parties without the written consent of the ENGINEER. In the event of a discrepancy between the hard copy and this electronic media at delivery or in the future, the hard copy shall govern. ENGINEER hereby disclaims any and all liability for the consequences from use of the electronic media and makes no warranty or guarantee of accuracy. RECIPIENT shall assume full responsibility for the uses and consequences of the electronic media. It is agreed that ENGINEER has and retains ownership of the electronic media. ENGINEER does not warrant or guarantee that the electronic data is compatible with RECIPIENT'S computer hardware or software, and ENGINEER'S responsibility for the electronic media is limited to replacement of defective media for a period of thirty (30) days after delivery to RECIPIENT. !!! By opening and using this FILE, You AGREE to these TERMS AND CONDITIONS!!!

**PROPOSAL
PROJECT NO.
TMUA-W 18-19 C2**

TO: TULSA METROPOLITAN UTILITY AUTHORITY
CITY OF TULSA, OKLAHOMA

THE UNDERSIGNED BIDDER, having carefully examined the drawings, specifications, and other Contract Documents of the above project presently on file in the City Clerk, City of Tulsa Oklahoma:

CERTIFIES THAT he has inspected the site of the proposed work and has full knowledge of the extent and character of the work involved, construction difficulties that may be encountered, and materials necessary for construction, class and type of excavation, and all other factors affecting or which may be affected by the specified work; and

CERTIFIES THAT he has not entered into collusion with any other bidder or prospective bidder relative to the project and/or bid; and

HEREBY PROPOSES: to enter into a contract to provide all necessary labor, materials, equipment and tools to completely construct and finish all the work required by the Contract Documents referred to therein; to complete said work within 280 calendar days after the work order is issued; and to accept in full payment therefore the amount set forth below for all work actually performed as computed by the Engineers as set forth in the Contract.

Basis of Award

IT SHOULD BE NOTED THAT THE LOWEST RESPONSIBLE BID SHALL BE DETERMINED BY THE TOTAL BASE BID.

Note: - Item numbers omitted are not a part of the Contract.

PROPOSAL FOR
PROJECT NO. TMUA-W 18-19 C2

ITEM NUMBER	SPEC NUMBER	ITEM DESCRIPTION	UNIT	QUANTITY	DATA INPUT UNIT PRICE	AMOUNT
1	01 29 00	MOBILIZATION	EA	1		
2	01 50 00	EROSION CONTROL	EA	1		
3	01 50 00	TRAFFIC CONTROL	EA	1		
4	02 41 00	DEMOLITION	EA	1		
5	05-C-401	84-INCH FLOW METER	EA	1		
6	22-X-110	RAPID MIX BOX NO. 3 - METAL STAIRS	EA	1		
7	22-X-110	RAPID MIX BOX NO. 3 - REPLACE EXISTING GRATING WITH NEW GRATING, BEAMS AND PLATES	SF	125		
8	22-M-110	RAPID MIX BOX NO. 3 - 1-INCH ALUMINUM CHLOROHYDRATE CPVC PIPE WITH FITTINGS AND VALVES	LF	100		
9	22-M-110	RAPID MIX BOX NO. 3 - 1-INCH COAGULANT AID POLYMER CPVC PIPE WITH FITTINGS AND VALVES	LF	120		
10	22-M-110	RAPID MIX BOX NO. 3 - 48-INCH INFLUENT SLIDE GATE	EA	2		
11	22-M-110	RAPID MIX BOX NO. 3 - RAPID MIXER	EA	2		
12	25-S-110	RAW WATER CONTROLLER VAULT - ACCESS STRUCTURE	EA	1		
13	25-S-110	RAW WATER CONTROLLER VAULT - ALUMINUM DOOR AND FRAME	EA	1		
14	25-S-110	RAW WATER CONTROLLER VAULT - CONCRETE COATINGS	EA	1		
15	25-S-110	RAW WATER CONTROLLER VAULT - EXHAUST FAN	EA	1		
16	05-C-100	RAW WATER CONTROLLER VAULT - REMOVE AND REPLACE 36-INCH ISOLATION BUTTERFLY VALVE	EA	3		
17	30-S-110	CLARIFIER NO. 3 - GROUND PENETRATING RADAR	EA	1		
18	30-S-110	CLARIFIER NO. 3 - INJECT GROUT UNDER SLAB	CY	50		
19	30-S-110	CLARIFIER NO. 3 - WALL CRACK INJECTION	LF	240		
20	30-S-110	CLARIFIER NO. 3 - FLOOR JOINT CHEMICAL INJECTION	LF	1,950		
21	30-S-403	CLARIFIER NO. 3 - WALKWAY CRACK INJECTION	LF	50		
22	30-S-403	CLARIFIER NO. 3 - REPAIR DEFICIENT CONCRETE SURFACES	SF	14,290		
23	30-S-110	CLARIFIER NO. 3 - CONCRETE WALLS	CY	41		
24	30-S-110	CLARIFIER NO. 3 - CONCRETE COLUMNS AT DIFFUSER WALLS	EA	26		
25	30-S-302	CLARIFIER NO. 3 - CONCRETE PIER SUPPORTS AT FLOCCULATOR PADDLES DET 2	EA	12		
26	30-S-401	CLARIFIER NO. 3 - CONCRETE PIER SUPPORTS AT FLOCCULATOR PADDLES DET 4	EA	8		
27	30-S-110	CLARIFIER NO. 3 - SUPPORT COLUMN FOUNDATION TYPE A	EA	8		
28	30-S-110	CLARIFIER NO. 3 - SUPPORT COLUMN FOUNDATION TYPE B	EA	4		
29	30-S-120	CLARIFIER NO. 3 - CONCRETE ELEVATED DECK	CY	48		
30	30-S-110	CLARIFIER NO. 3 - CONCRETE FILL	CY	1,670		
31	30-S-120	CLARIFIER NO. 3 - CONSTRUCT METAL STAIRS	EA	1		
32	30-S-401	CLARIFIER NO. 3 - ALUMINUM GRATING AND REMOVABLE HATCH AT EXISTING OPENING	SF	40		
33	30-S-402	CLARIFIER NO. 3 - ALUMINUM GRATING	SF	15		
34	30-S-120	CLARIFIER NO. 3 - LADDER	EA	2		
35	30-S-120	CLARIFIER NO. 3 - FLOCCULATION STAGE DIVIDERS	EA	1		
36	30-S-110	CLARIFIER NO. 3 - CONCRETE COATINGS	EA	1		
37	30-M-110	CLARIFIER NO. 3 - 4-INCH SLUDGE SST PIPE WITH FITTINGS	LF	36		
38	30-M-110	CLARIFIER NO. 3 - 4-INCH PLUG VALVE	EA	6		
39	30-M-302	CLARIFIER NO. 3 - 12-INCH DR DI PIPE WITH FITTINGS	LF	49		
40	30-M-120	CLARIFIER NO. 3 - WATER MONITOR	EA	4		
41	35 20 16	CLARIFIER NO. 3 - EFFLUENT SLIDE GATE	EA	2		
42	44 42 63	CLARIFIER NO. 3 - SLUDGE COLLECTORS	EA	6		
43	44 44 57	CLARIFIER NO. 3 - PLATE SETTLERS INCLUDING EFFLUENT TROUGHS AND WALKWAY	EA	24		
44	44 44 36	CLARIFIER NO. 3 - FLOCCULATORS, DRIVE AND PADDLE ASSEMBLY	EA	8		
45	41-S-110	SLUDGE PUMP STATION NO. 1 - ACCESS STRUCTURE	EA	1		
46	40-M-110	SLUDGE PUMP STATION NO. 2 - 4-INCH SLUDGE DI PIPE WITH FITTINGS	LF	8		
47	40 27 02	SLUDGE PUMP STATION NO. 2 - 4-INCH PLUG VALVE	EA	2		
48	40 27 02	SLUDGE PUMP STATION NO. 2 - 4-INCH CHECK VALVE	EA	1		
49	40-M-110	SLUDGE PUMP STATION NO. 2 - SLUDGE PUMP	EA	1		
50	25-S-110 30-S-120 41-S-110	HANDRAIL	LF	1,945		
51	30-M-110	BURIED 4-INCH W1 DI PIPE WITH FITTINGS	LF	50		
52	12-E-110	ELECTRICAL AT RAPID MIX BOX NO. 3	EA	1		

53	20-E-120	ELECTRICAL AT CLARIFIER NO. 3	EA	1		
54	05-E-100	ELECTRICAL AT RAW WATER CONTROLLER VAULT	EA	1		
55	40-E-110	ELECTRICAL AT SLUDGE PUMP STATION NO. 2	EA	1		
56	40 90 01	I&C AT CLARIFIER NO. 3	EA	1		
57	40 90 01	I&C AT SLUDGE PUMP STATION NO. 2	EA	1		
58	25-S-110	CLARIFIER 2&3 VENTURI AND BUTTERFLY VALVE	EA	2		
59	30-M-120	CLARIFIER NO. 4 - WATER MONITOR	EA	3		
60	30-M-120	CLARIFIER NO. 1 - WATER MONITOR	EA	2		
61	01 29 00	OWNER'S ALLOWANCE	ALLOW	1	\$300,000.00	\$300,000.00
62	01 29 00	AS-BUILT DRAWINGS	EA	1		
63	01 29 00	LUCITY DATABASE ASSET MANAGEMENT SPREADSHEET	EA	1		
64	01 29 00	ALL OTHER WORK SPECIFIED AND SHOWN ON DRAWINGS OR SPECIFICATIONS BUT NOT COVERED IN OTHER BID ITEMS	EA	1		
TOTAL						\$300,000.00

TOTAL BASE BID

\$300,000.00
Figures

Enclosed is a () Bidder's Surety Bond, () Certified Check, () Cashier's Check for

_____ Dollars (\$ _____)
Figures

which the City of Tulsa may retain or recover as liquidated damages in the event that the undersigned fails to enter into contract for the work covered by this proposal., provided the Contract is awarded to the undersigned within thirty (30) days, or within ninety (90) days if Federal funds are utilized, from the date fixed for opening of bids and the undersigned fails to execute said Contract and furnish the required bonds and other requirements as called for in these Contract Documents within thirty (30) days after award of Contract.

Dated at Tulsa, Oklahoma, this _____ day of _____, 20__.

Respectfully submitted,

(Complete legal name of company)

(State of Organization)

By:

Title:

Printed Name:

ATTEST:

Title: Corporate Secretary

Printed Name:

(SEAL)

Address: _____

Telephone Number: _____

Fax Number: _____

The undersigned acknowledge receipt of the following Addenda (give number and date of each):



CITY OF
Tulsa
A New Kind of *Energy*™

FAX TRANSMITTAL

Date: July 5, 2022

To: Plan Holders

Company: Contractors

Number of Pages: **10** (Including Cover)

From: Anika Ture - Contract Administration
Telephone No. 918-596-9637
Fax No. 918-699-3470
Email – ature@cityoftulsa.org

RE: **Project No. TMUA-W 18-19 C2 A.B. Jewell Water Treatment
Plant Clarifier No. 3 Improvements**

ADDENDUM NO. 2

Please fax or email a signed cover sheet 918-699-3470 to or
tcurry@cityoftulsa.org as acknowledgement of receipt.

Thank you,

Signature

Company

Date