


SIDE VIEW

TOP VIEW

TYPICAL FIRE HYDRANT INSTALLATION

NOTE: HYDRANT DRAIN MUST BE LEFT CLEAN AFTER POURING CONCRETE BLOCKING.

RESTRAINING GLANDS MAY BE USED IN LIEU OF CONCRETE BLOCKING.

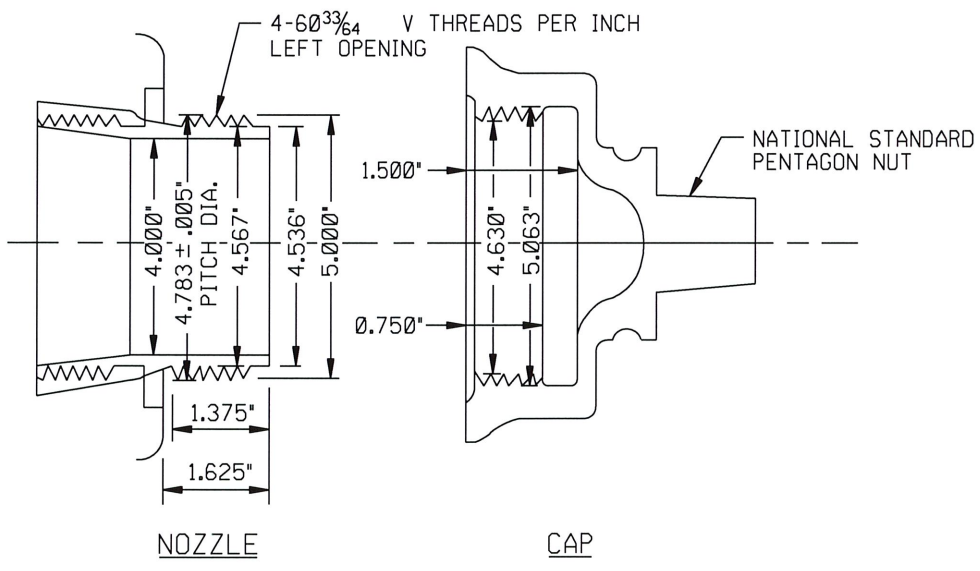

NOZZLE

CAP

TULSA STANDARD THREADS - PUMPER NOZZLE

STANDARD DETAIL FIRE HYDRANT	
CITY OF TULSA, OKLAHOMA ENGINEERING SERVICES DEPARTMENT	
DRAWN BY: R.M.O. CHECKED BY: <i>HAS</i> DATE: MARCH 2022	APPROVED <i>[Signature]</i>
NOT TO SCALE	STANDARD NO. 309