


DRIVEWAY SECTION

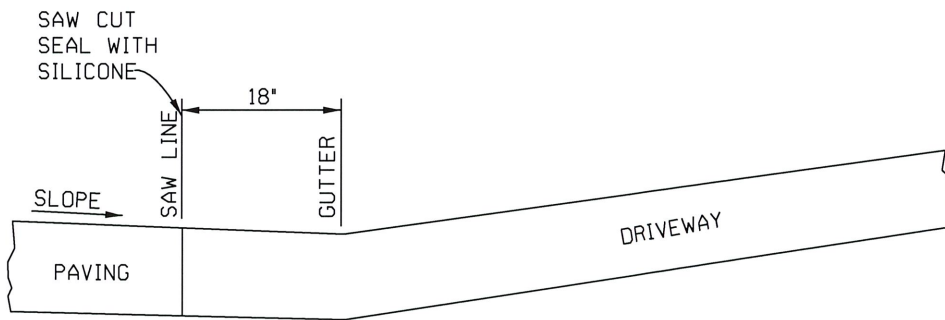

SECTION AT GUTTER

- \* PROVIDE 5'X5' SIDEWALK PANEL AT DRIVEWAYS, OR EVERY 200' MAXIMUM
- \* MAXIMUM 24' DRIVEWAY, WIDTH GREATER THAN 24' REQUIRES APPROVAL BY THE ZONING CODE
- \* COMPACTION OF AGGREGATE BASE SHALL BE ACCORDING TO CITY OF TULSA STANDARD

SIDEWALKS AND RAMPS SHALL MEET THE ADA ACCESSIBILITY TECHNICAL REQUIREMENTS AS SHOWN AT [WWW.ACCESS-BOARD.GOV/PROWAG/](http://WWW.ACCESS-BOARD.GOV/PROWAG/)

RESIDENTIAL CONCRETE DRIVEWAY  
CONCRETE STREET

CITY OF TULSA, OKLAHOMA  
ENGINEERING SERVICES DEPARTMENT

DRAWN BY: L.M.V.  
CHECKED BY: *HAS*  
DATE: MARCH 2022

APPROVED  
*[Signature]*

NOT TO SCALE

STANDARD NO. 701