

1 FT. MIN.

SAWCUT FULL DEPTH

TRENCH EXCAVATION LIMITS

SEE GENERAL NOTE NO. 2

# GENERAL NOTES

- 1. A STREET CUT PERMIT SHALL BE OBTAINED FOR ANY STREET CUTS BEFORE
- 2.MATERIAL WITHIN 4 IN.OF PIPE SHALL BE EITHER COMPACTED 3/4°TO NO.4 CRUSHED STONE, FLOWABLE FILL CONCRETE, OR MAY BE ANY SUITABLE MATERIAL APPROVED IN WRITING BY THE ENGINEERING DIRECTOR. IF FLOWABLE FILL IS USED AS BACKFILL MATERIAL, THEN EMBEDMENT MATERIAL MUST BE FLOWABLE FILL
- 3. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH CURRENT ODOT SPECIFICATIONS, THE CITY OF TULSA STANDARDS AND SPECIAL PROVISIONS AS NOTED
- 4. WHERE MATERIALS ARE TRANSPORTED IN THE PROSECUTION OF THE WORK, VEHICLES SHALL NOT BE LOADED BEYOND THE LOADING CAPACITY RECOMMENDED BY THE AMNUFACTURER OF THE VEHICLE OR PRESCRIBED BY ANY FEDERAL, STATE, OR LOCAL LAW OR REGULATION. WHERE IT IS NECESSARY TO CROSS CURBING OR SIDEWALKS, PROTECTION AGAINST DAMAGE SHALL BE PROVIDED BY THE CONTRACTOR AND ANY DAMAGE TO ROADS, CURBING, OR SIDEWALKS SHALL BE REPAIRED BY THE C.O.T. PAVEMENT CUT CONTRACTOR AT THE EXPENSE OF THE PERMIT HOLDER.
- 5. TRAFFIC CONTROL: ALL WORK SHALL BE DONE IN COOPERATION WITH THE CITY TO ESTABLISH, INSTALL, MAINTAIN, AND OPERATE COMPLETE, ADEQUATE, AND SAFE TRAFFIC CONTROL DURING THE ENTIRE CONSTRUCTION PERIOD. BARRICADES, SIGNS, LIGHTS SHALL BE APPROVED BY THE TRAFFIC ENGINEER OF THE C.O.T. ALL TRAFFIC CONTROL ITEMS SHALL BE PROMPTLY REMOVED UPON COMPLETION OF THE WORK
- 6. ALL LONGITUDINAL TRENCHES EXCEEDING 300 LINEAR FEET SHALL BE BACKFILLED AND MADE DRIVEABLE PRIOR TO EXCAVATING ANY ADDITIONAL TRENCH.
- 7. ALL SIDEWALK AND/OR CURB CONSTRUCTION OR RECONSTRUCTION, WITHIN THE STREET RADIUS, SHALL INCLUDE THE INSTALLATION OF A STANDARD WHEELCHAIR RAMP AS A PART OF THE CONSTRUCTION.
- 8. CONTACT THE CITY OF THE SA TRAFFIC ENGINEERING DIVISION AT 918-596-9766 REFORE REMOVING OR REPLACING ANY TRAFFIC CONTROL DEVICES, INCLUDING, BUT NOT LIMITED TO, STRIPING AND REFLECTORS, SCHOOL CROSSING STRIPING AND DEVICES, ETC.
- 9. ALL EXISTING PAVEMENT CONTROL JOINTS SHALL BE RE-ESTABLISHED.
- 10. COMPACTION SHALL BE PER SECTION 303.04.E OF THE CURRENT EDITION OF THE STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION, AND APPLICABLE SUPPLEMENTS, AS PUBLISHED BY THE OKLAHOMA DEPARTMENT OF TRANSPORTATION
- 11. JOINTS SHALL NOT BE PLACED IN VEHICLE WHEEL PATH.

1. BACKFILL IA. BACKFILL UNDER PAVEMENT SHALL BE BY ONE OF THE FOLLOWING METHODS: . AGGREGATE BASE MATERIAL SHALL BE PLACED IN 8 IN MAXIMUM LIFTS
AND SHALL BE COMPACTED TO 100% STANDARD DENSITY AASHTO 180, METHOD D AS MEASURED BY THE NUCLEAR DENSITY METHOD, COMPACTION SHALL BE

DONE BY A VIBRATORY HAND TAMPER, PER GENERAL NOTE 10.

## 2. QUICK-SET FLOWABLE FILL 1B. BACKFILL OUTSIDE OF PAVEMENT

CONSTRUCTION NOTES

COMPACTION SHALL BE 95% STD. DENS. PER SECTION 303,04 (E) OF THE CURRENT EDITION OF THE STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION, AND APPLICABLE SUPPLEMENTS, AS PUBLISHED BY THE OKLAHOMA DEPARTMENT OF TRANSPORTATION.

IC. AGGREGATE BASE MATERIAL

THIS MATERIAL COMMONLY CALLED 11/2 IN TYPE A AGGREGATE BASE SHALL HAVE THE FOLLOWING GRADATION WHICH IS ODOT SECTION 703.01.C TYPE A.

SQUARE (MM)	TYPE A
1-1/2 IN. (37.5)	100
3/4 IN. (19.0)	40-100
3/8 IN. (9.5)	30-75
NO. 4 (4.75)	25-60
NO. 10 (2.00)	20-43
NO. 40 (0.425)	8-26
NO. 200 (0.075)	4-12

ID. THE SAND SHALL HAVE 100% PASSING THE 3/4 INCH SIEVE AND 0% - 20%

BEFORE ANY RESTORATION, PAVEMENT THAT HAS BEEN UNDERMINED SHALL BE RE-MOVED TO STABLE MATERIAL BY SAWCUT AS PER DETAIL. ALL PAVEMENT REMOVAL SHALL BE A MINIMUM OF 5 FEET BY 5 FEET. CONCRETE FOR THE REPLACEMENT OF PAVEMENT, CURBS AND SIDEWALKS SHALL BE HIGH EARLY STRENGTH CLASS A AS PER ODOT SECTION 701.01.

### 3. ASPHALT

ALL ASPHALT SHALL BE ODOT TYPE 'S4'. THE ASPHALT SHALL BE COMPACTED TO 92% MAXIMUM DENSITY AS DETERMINED BY AASHTO T-209 METHOD. SPREADING AND FINISHING OF ASPHALT TO MEET ODOT SECTION 411.04.1
EDGES OF CUT SHALL BE SAW CUT TO FULL DEPTH.
PRIOR TO PLACEMENT OF ASPHALT IN CUT A TACK COAT SHALL BE UNIFORMLY APPLIED. PRIOR TO PLACEMENT OF ASPHALT IN CUT A HARK CUAT SHALL BE UNIVIDUAL BEFORE AFFALED. TACK COAT SHALL BE IN ACCORDANCE WITH SECTION 407 OF THE ODOT SPECIFICATIONS. ALL SURFACE EDGE JOINTS OF THE CUT/OVERLAY SHALL BE SEALED WITH AN ASPHALT RUBBER METING OR EXCEEDING THE REQUIREMENTS OF ASTM D6690. IF CURB AND GUTTER ARE REMOVED THEY SHALL BE REPLACED TO THE STANDARDS AND SPECIFICATIONS OF THE TYPICAL EXISTING CURB AND GUTTER MATERIALS FOR ASPHALTIC CONCRETE SHALL MEET ODOT SECTION 708.

## 4. REVEGETATION


ALL AREAS OUTSIDE THE PAVED PORTION OF THE RIGHT OF WAY WHERE VEGETATION HAS BEEN REMOVED SHALL BE RESTORED BY SODDING, AND MAINTAINED UNTIL

### 5. JOINTS

WHEN ONE OR MORE LONGITUDINAL CONSTRUCTION JOINT IS REMOVED FOR A STREET CUT, THE JOINT SHALL BE RE-ESTABLISHED AS PER THE PAVEMENT STANDARDS FOR PORTLAND CEMENT CONCRETE.

DOWEL BARS SHALL BE INSTALLED IN ACCORDANCE WITH THE ENGINEERING SERVICES DEPARTMENT CRITERIA FOR LOAD TRANSFER DEVICES, AS SHOWN IN THE DETAILS ON

7. IF FLOWABLE FILL IS UTILIZED, IT SHALL BE PLACED IN LIFTS TO PREVENT FLOTATION OF THE PIPE AND BE A MINIMUM OF 3 FEET BY 3 FEET FOR PAVEMENT REMOVAL.

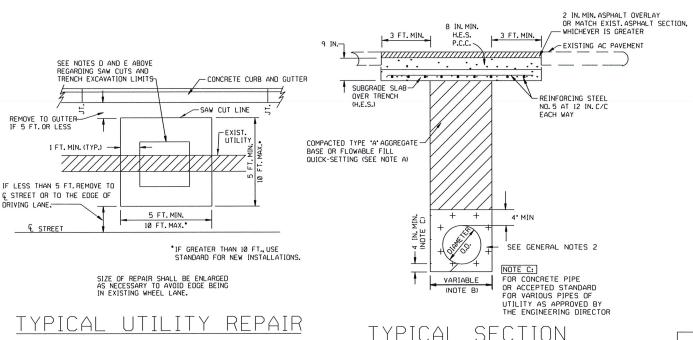

FOR STATE HIGHWAYS THAT ARE ARTERIAL STREETS

BY DATE REVISION

CITY OF TULSA, OKLAHOMA NGINEERING SERVICES DEPARTMENT

STANDARD ASPHALT PAVEMENT CUT AND REPAIR

DATE: MARCH 2022 STD. 730

WIDTH SHALL BE PIPE O.D. PLUS 12 INCHES. YPICAL SECTION

5 FT. MIN.

VARIARI E

IN. MIN. ASPHALT OVERLAY

OR MATCH EXISTING PAVEMENT SECTION,
WHICHEVER IS GREATER

COMPACTED TYPE A AGGREGATE BASI

OR FLOWABLE FILL QUICK-SETTING

(SEE NOTE A)

VARIABLE TRENCH WINTH

SEE NOTE B

- 4 IN. MIN.

(NOTE C)

N. MIN. HIGH EARLY STRENGTH P.C.C.

1 FT. MIN.

SAWCUT FULL DEPTH

NOTE A:

- EXIST.

PAVEMENT :

FOR EXCAVATIONS WHERE THE

THE TOP OF PIPE IS GREATER THAN

6 FEET, AND WHERE THE TRENCH

THE APPLICANT SHOULD CONSIDER

AN ENGINEERED FILL USING OTHER SUITABLE, COMPACTABLE MATERIALS

AS APPROVED IN WRITING BY THE

ENGINEERING DIRECTOR.

NOTE B: MINIMUM TRENCH WIDTH SHALL BE AS FOLLOWS:

IF CRUSHED STONE BEDDING IS USED, MINIMUM

TRENCH WIDTH SHALL BE PIPE O.D. + 16

IF FLOWABLE FILL IS USED, MINIMUM TRENCH

WINTH IS SUFFICIENT FOR USE OF HEAVY COMPACTION EQUIPMENT,

DIFFERENCE IN FLEVATION BETWEEN THE FINISHED GRADE AND