


TYPICAL FIRE HYDRANT INSTALLATION

NOTE: HYDRANT DRAIN MUST BE LEFT CLEAN AFTER POURING CONCRETE BLOCKING.

RESTRAINING GLANDS MAY BE USED IN LIEU OF CONCRETE BLOCKING.

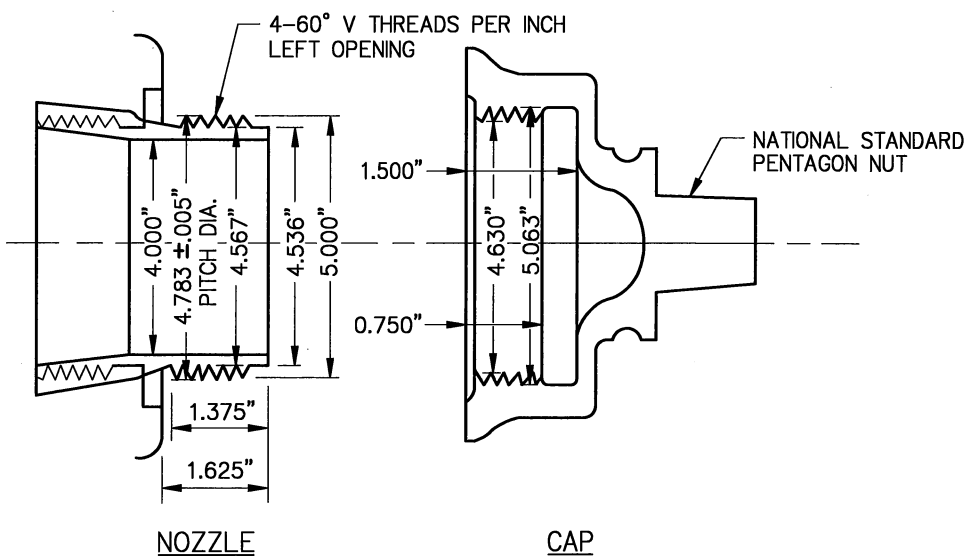

TULSA STANDARD THREADS - PUMPER NOZZLE

STANDARD DETAIL FIRE HYDRANT	
CITY OF TULSA, OKLAHOMA ENGINEERING SERVICES DEPARTMENT	
DRAWN BY: S.R.W.	APPROVED:
CHECKED BY:	
DATE: OCTOBER 2013	
NOT TO SCALE	STANDARD NO. 309