



NOTE:
 (2) 5/8" x 8' COPPER CLAD
 GROUND RODS SPACED 6FT
 APART ARE REQUIRED FOR
 ALL SERVICES. #4 BARE
 COPPER WIRE SHALL BE
 BONDED AND CONNECTED
 FROM SERVICE TO EACH
 GROUND ROD.

PEDESTAL SERVICE INSTALLATION – SECTION A-A

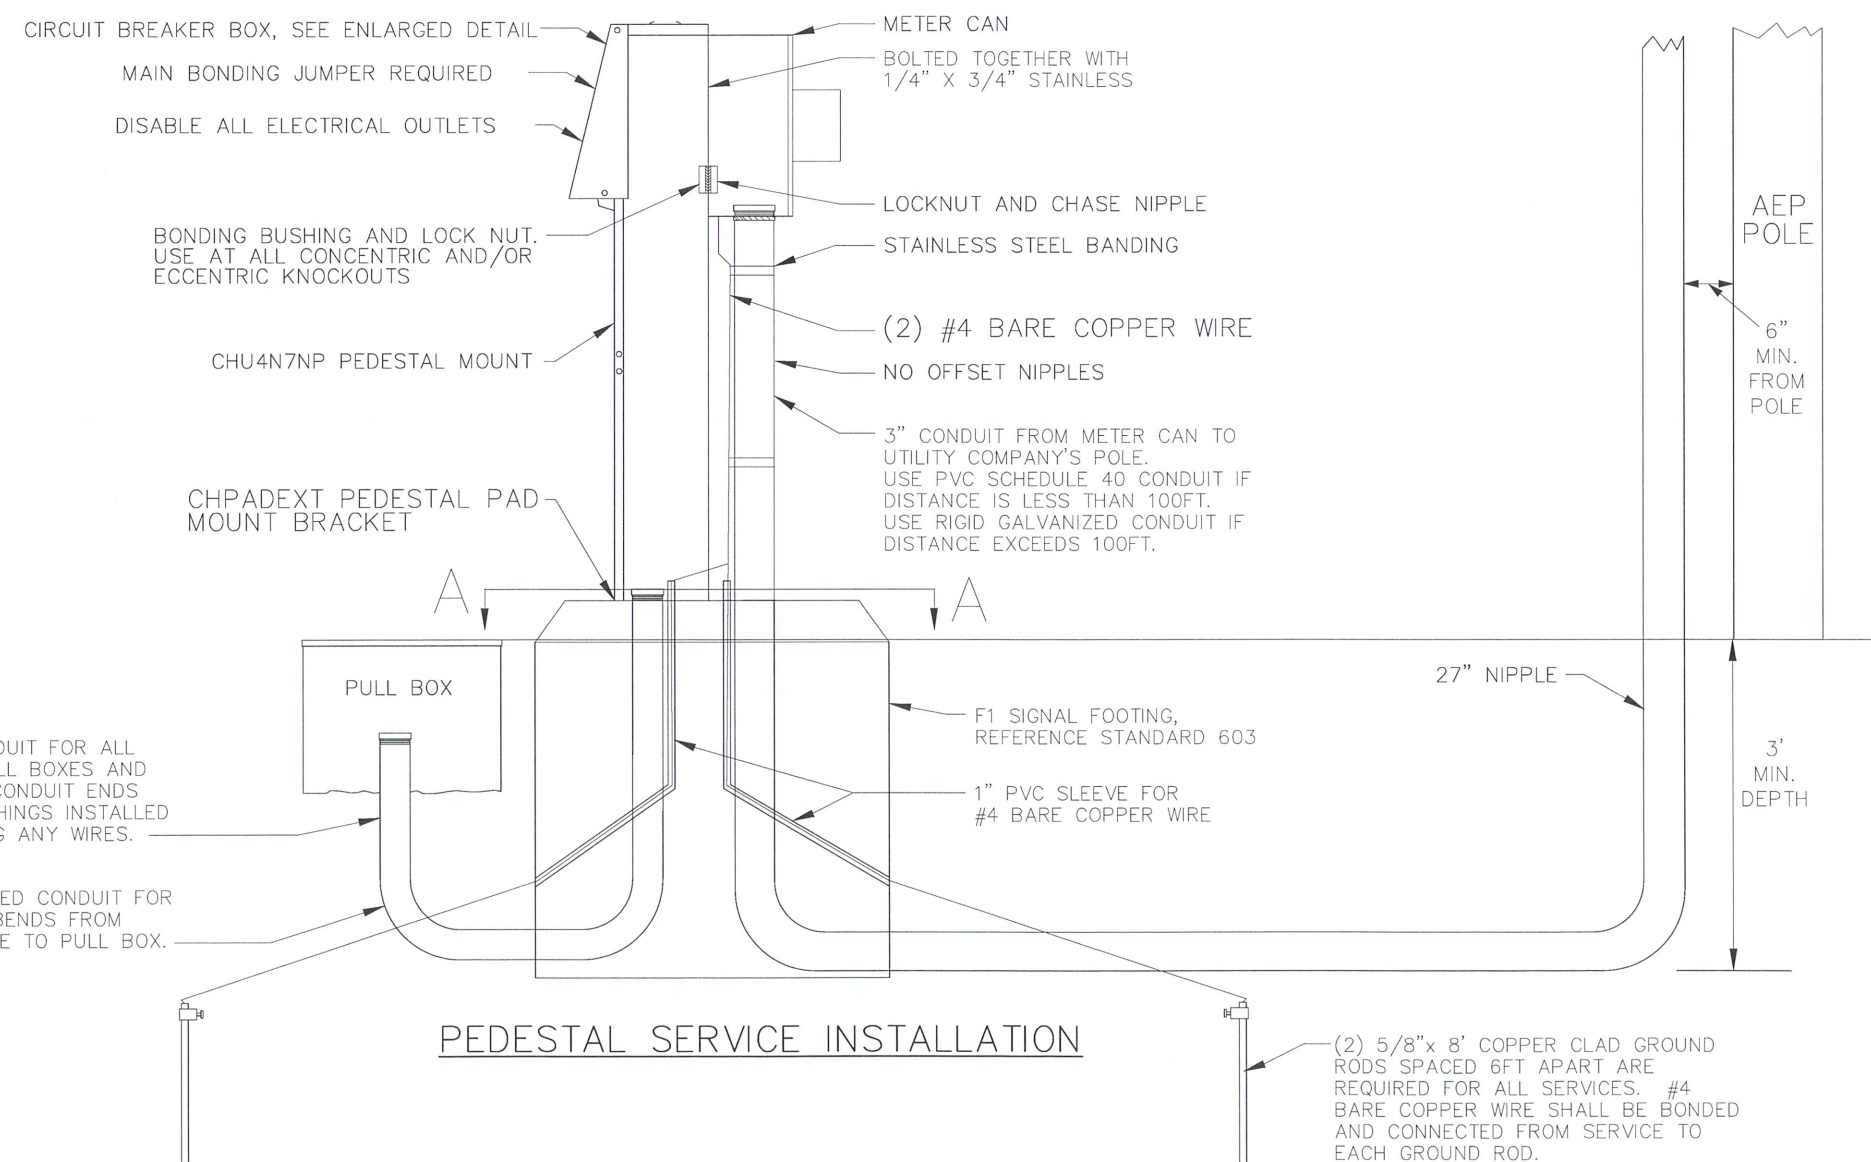

TYPICAL:
 USE 2" PVC CONDUIT FOR ALL
 STUB UPS AT PULL BOXES AND
 FOOTINGS. ALL CONDUIT ENDS
 SHALL HAVE BUSHINGS INSTALLED
 PRIOR TO PULLING ANY WIRES.

TYPICAL:
 USE 2" GALVANIZED CONDUIT FOR
 ALL 90 DEGREE BENDS FROM
 PEDESTAL SERVICE TO PULL BOX.

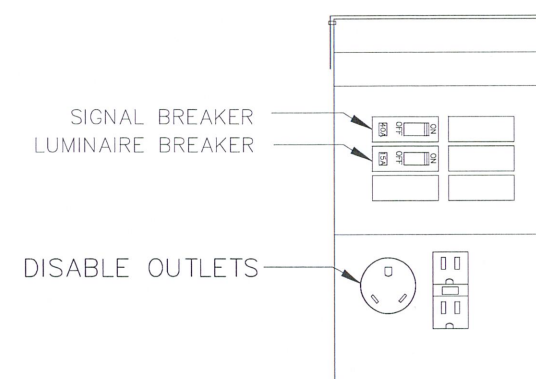

NOTE:
 LABELS SHALL BE ADDED FOR ALL
 SERVICE DISCONNECTS

CIRCUIT BREAKER BOX AND SERVICE DISCONNECTS

(2) 5/8" x 8' COPPER CLAD GROUND
 RODS SPACED 6FT APART ARE
 REQUIRED FOR ALL SERVICES. #4
 BARE COPPER WIRE SHALL BE BONDED
 AND CONNECTED FROM SERVICE TO
 EACH GROUND ROD.

REVISION	BY	DATE

T. J. Smith
 CITY ENGINEER

Robert W. Knight
 CITY TRAFFIC ENGINEER

CITY OF TULSA, OKLAHOMA

TRAFFIC SIGNAL
 PEDESTAL SERVICE

DATE: MARCH 2025

STD. 607B