


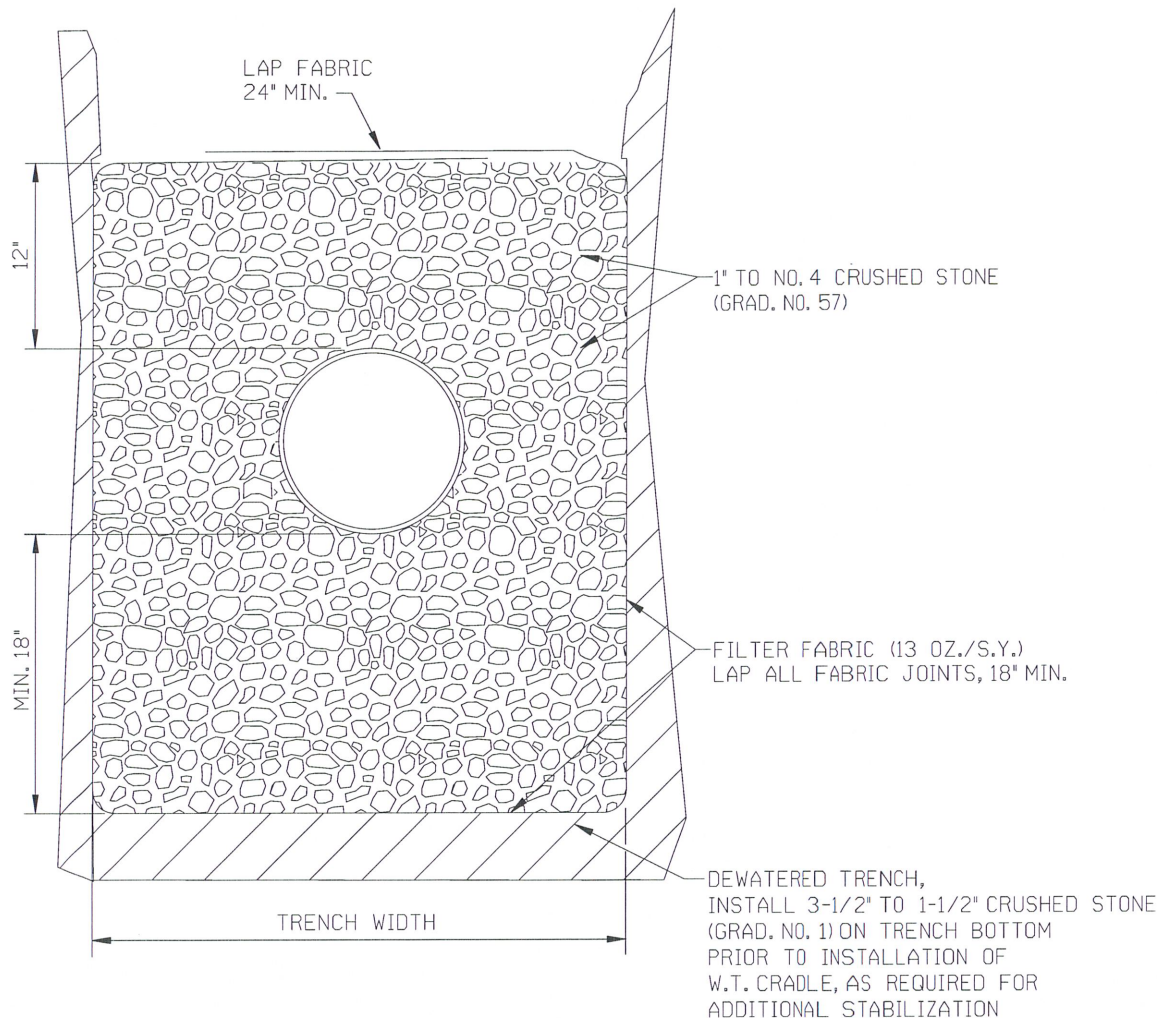

MINIMUM TRENCH WIDTH FOR FLEXIBLE PIPES	
PIPE I.D.	MIN. TR. WIDTH
8" - 12"	3' - 0"
14" - 18"	4' - 6"
20" - 24"	6' - 0"
26" - 30"	7' - 6"
32" - 36"	9' - 0"

NOTE:
FOR FLEXIBLE PIPE TYPES, SEE NOTE 1 ON
STANDARD NO. 305, TRENCH AND BEDDING DETAIL
FOR FLEXIBLE PIPE.

NOTE:

1. SLIDING TRENCH SUPPORTS SHALL NOT BE PLACED BELOW THE TOP OF THE PIPE.
2. WATER TABLE CRADLE SHALL BE INSTALLED FOR THE FULL WIDTH OF THE TRENCH EXCAVATION.
3. FOR RIGID PIPES USE THE TRENCH WIDTH IN STANDARD NO. 304, TRENCH AND BEDDING DETAIL FOR RIGID PIPE. SEE TABLE FOR FLEXIBLE PIPES.

STANDARD DETAIL WATER TABLE CRADLE	
CITY OF TULSA, OKLAHOMA	
DRAWN BY: D.J.N.	APPROVED
CHECKED BY: <i>tdp</i>	<i>[Signature]</i>
DATE: AUGUST 22 2025	
NOT TO SCALE	STANDARD NO. 367