
TYPICAL LOCATION LONG SERVICE




TYPICAL LOCATION SHORT SERVICE

## NOTE:


- 1. CONTRACTOR SHALL BE RESPONSIBLE TO FURNISH FITTINGS COMPATIBLE WITH THE TYPE OF PIPE FURNISHED.
- NOTICE SHALL BE GIVEN TO THE ENGINEERING SERVICES DEPT. 48 HOURS IN ADVANCE SO THAT A REPRESENTATIVE OF THE DEPT. MAY INSPECT THE MATERIALS.
- 3. WHERE RESTRAINED JOINTS ARE REQUIRED, THEY SHALL BE EBAA MEGALUG SERIES 1100 OR EQUAL.
- 4. USE DUCTILE IRON PIPING AND FITTINGS FROM THE MAIN LINE TAPPING SLEEVE TO DOWNSTREAM FROM THE METER CHECK VALVE AT THE CONNECTING SLEEVE. PIPE SHALL BE WRAPPED WITH POLYETHYLENE FILM AND TAPED.
- 5. BACKFLOW PREVENTER TO BE INSTALLED IN BUILDING.
- 6. LOCATE GALVANIZED METER CAN IN GREEN AREAS ONLY.
- 7. TAPPING SLEEVE AND VALVE CONNECTIONS ARE APPROVED ON AN AS NEEDED BASIS THROUGH A TECHNICAL VARIANCE.


## TO BE FURNISHED AND INSTALLED BY CONTRACTOR


- 1 TEE 1 VALVE BOX 1 VALVE 1 DETECTOR CHECK ASSEMBLY
- 1 FLANGED COUPLING ADAPTER, FLJ X MJ DRESSER 128 , OR EQUAL 1 METER CAN W/ RIM AND LID PIPE TYPE MATERIAL AS REQUIRED

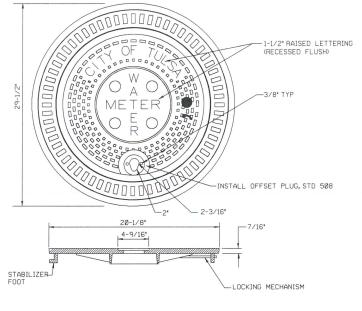


METER BOX RING AND COVER

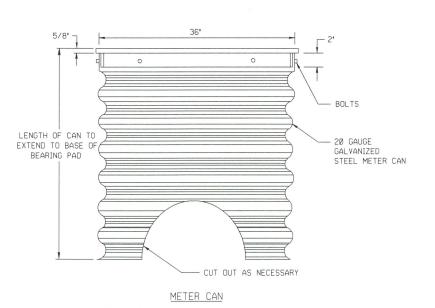

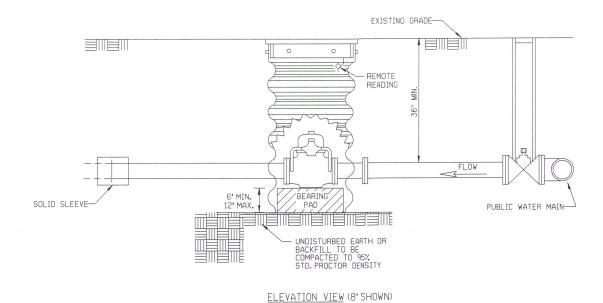

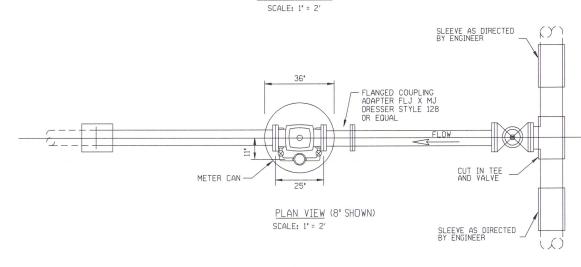

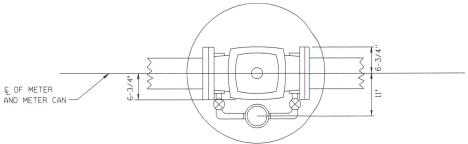

DETAIL PLAN VIEW (8" SHOWN) SCALE: 1' = 1'



CITY OF TULSA

STD. 551

BY DATE REVISION 4", 6", 8" DETECTOR CHECK ASSEMBLY AND METER CAN DATE: MAY 2025